


BASE GENERAL NOTES

- PRECAST CONCRETE SHALL BE EXPOSURE CLASS HSe AND MEET MIN COMPRESSIVE STRENGTH OF 30MPa @28d
 - AIR CATEGORY: 4.0% - 7.0% (EXCEPT WHERE ZERO-SLUMP CONCRETE IS USED)
 - AGGREGATE: CSA/CAN A23.4 MAXIMUM SIZE: 20mm
 - ADMIXTURES: CSA/CAN A23.4
 - REINFORCING: GRADE 400W CSA G30.18, 3x12 W2.5/W2.5
 - INSERT/EMBEDS: AS NOTED IN DRAWING DETAILS
 - MANUFACTURE OF PRECAST CONCRETE UNITS SHALL BE IN ACCORDANCE WITH SPECIFICATION CSA A23.4
- ** LEKO PRECAST LTD. SHALL NOT BE RESPONSIBLE FOR INSTALLATION PRACTICES FOLLOWED ON-SITE UNLESS PERFORMED BY LEKO PRECAST LTD. **

935Kg (2,060 LBS)

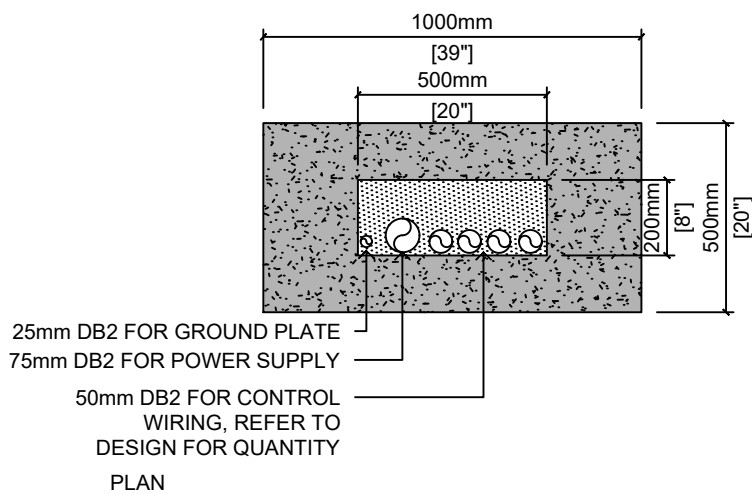

NOTES:

- REFER TO IRRIGATION DESIGN FOR REQUIRED COMMUNICATION HARDWARE
- CONTRACTOR TO CONNECT HYDROMETER AND PROGRAM MASTER VALVE AND FLOW SENSING FUNCTIONS PRIOR TO SUBSTANTIAL COMPLETION
- CONTRACTOR SHALL LABEL ALL WIRES

DETAIL TITLE:

DETAIL No.: **SS-IR.01a**

SCALE: **1:20**

APRIL 2024